



Senze-Instruments

Senze-Instruments lot 1568877 Erichsen lot 4588

Device

Device: Tempod 20B (X2.4)

Serial Number: 470B100436

Current Status: Recording

Configurations

Logging Interval: 15m

Start Mode: Manual Start

AccessKey: Off

Logging Cycle: 300d

Start Delay: 10m

Logging Mode: Start&Stop

Stop Button: Enabled

Summary

Start Time: 13/11/2020 00:32

Stop Time: 24/11/2020 11:02

Data Points: 1099

Trip Length: 11d10h30m

Sensor 1 Temp

Max: 24.2°C @16/11/2020 01:17

Min: 14.1°C @14/11/2020 08:32

Avg: 20.0°C

MKT: 20.3°C


Alarms

Alarm Zone	Alarm Delay(Type)	Violation Time(Events)	Alarm First Triggered	Status
------------	-------------------	------------------------	-----------------------	--------

Sensor 1 Temp

Hi: >25.0°C	0m(Cumu.)	0m(0)		Ok
-------------	-----------	-------	--	----

Lo: <15.0°C	0m(Cumu.)	1d3h45m(2)	13/11/2020 17:02	Alarm
-------------	-----------	------------	------------------	-------

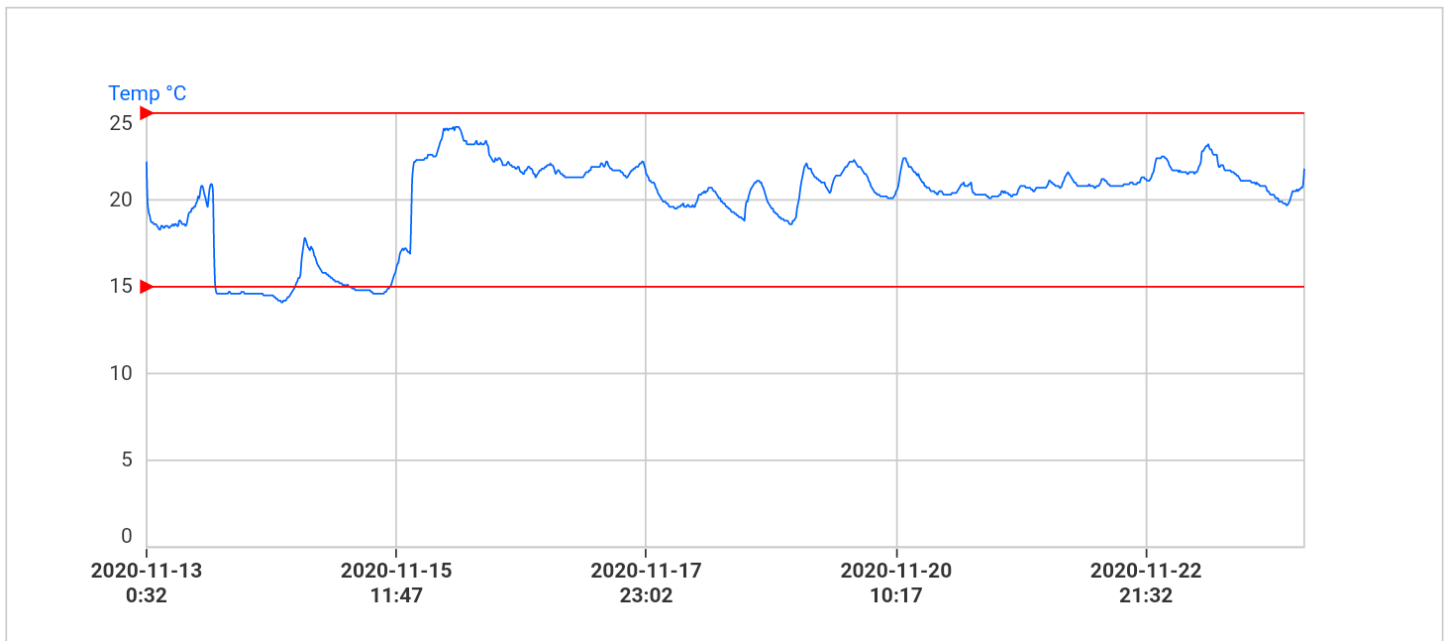



Data ID: 470B100436_JK12232154



Events

#	Description	Date/Time
1	Configure device	13/11/2020 00:21
2	Activate device	13/11/2020 00:22
3	Recording begins	13/11/2020 00:32
4	Download data	24/11/2020 11:12